



> GENERAL CHARACTERISTICS:

- R32 Eco Coolant
- Efficiency Class A++ / A+++
- 4 Filters: **Cold Catalyst, Active Carbon, Silver Ion and Biohepa.** New four-layer filter technology that purifies the air and removes gases, odours, formaldehydes, pollutants, bacteria, viruses and fungi from it
- New **Super Ioniser** that releases millions of ions to drastically reduce the presence of viruses and bacteria in the air
- Remote control with dedicated smartphone App
- **Compatible with the "Amazon Alexa" and "Google Home" voice assistants**
- Wide range of combinable powers
- Outdoor unit combinable with different types of indoor units
- Temperature display on board the machine
- Featuring direct current inverter technology
- Indoor unit with particularly appealing and modern design
- Outdoor unit equipped with fitting covers and sound-absorbent jacket
- Easily removable intake grille and filters for quick cleaning
- Automatic restart in case of a power outage
- Night operating mode / "AUTOMATIC" mode / Timer function
- Outdoor unit treated with protective anti-rust substances
- Wi-fi connectivity included



QUADRUPLE FILTER TECHNOLOGY & SUPER IONIZER



COMPATIBLE WITH




INDOOR UNIT



MODEL	W mm	H mm	D mm	Peso kg
9	805	285	194	7,6
12	805	285	194	7,6
18	957	302	213	10,0

OUTDOOR UNIT

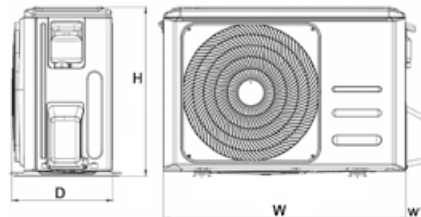

MODEL	W mm	W1 mm	H mm	D mm	Peso kg
18-2	800	70	554	333	35
21-3	845	69	702	363	43,3
27-3	845	69	702	363	48
28-4	946	84	810	420	62,1

OUTDOOR UNIT*			18-2	21-3	27-3	28-4
Power supply		V-Ph-Hz				
Cooling power ⁽¹⁾	nominal	W	5,275	6,155	7,915	8,205
	min-max	W	2,285 ~ 5,715	1,995 ~ 6,595	3,180 ~ 8,205	2,050 ~ 9,845
Power absorbed in cooling	nominal	W	1,635	1,905	2,450	2,540
	min-max	W	690 ~ 2,000	180 ~ 2,200	290 ~ 3,100	890 ~ 3,180
Current absorbed in cooling	nominal	A	7.3	8.3	11.2	11.3
	min-max	A	3.2 ~ 9.0	1.8 ~ 10.0	2.0 ~ 13.5	3.9 ~ 14.1
EER ref. Standard EN14511 (nominal)			3.23	3.23	3.23	3.23
Cooling	SEER		6.1	6.1	6.1	6.1
	PdesignC	kW	5.3	6.1	7.9	8.2
	Class ErP					
Thermal power ⁽²⁾	nominal	W	5,570	6,450	8,205	8,790
	min-max	W	2,405 ~ 5,745	1,450 ~ 6,680	2,285 ~ 8,500	2,345 ~ 10,550
Power absorbed in heating	nominal	W	1,500	1,738	2,210	2,200
	min-max	W	600 ~ 1,780	350 ~ 1,800	370 ~ 2,900	770 ~ 2,750
Current absorbed in heating	nominal	A	6.6	7.6	10.1	9.8
	min-max	A	2.80 ~ 7.95	2.6 ~ 8.0	2.4 ~ 13.0	3.4 ~ 12.2
COP ref. Standard EN14511 (nominal)			3.71	3.71	3.73	4.00
Heating Moderate climate zone	SCOP		3.8	4	4.0	3.8
	PdesignH	kW	4.8	5.4	5.6	6.5
	Class ErP					
	Tbiv / Tol	°C	-7 / -15	-7 / -15	-7 / -15	-7 / -15
Heating Warm climate zone	SCOP		5.1	4.8	5.1	4.6
	PdesignH	kW	5	5.6	6.1	6.9
	Class ErP					
	Tbiv / Tol	°C	2 / -15	2 / -15	2 / -15	2 / -15
Maximum power absorbed		W	3,050	3,910	4,100	4,150
Maximum current absorbed		A	12	17	18	19
Inrush current		A				
Outdoor unit	Air flow rate	m³/h	2,100	3,000	3,000	3,800
	Sound pressure ⁽³⁾	dB(A)	54	58	58	61.5
	Sound power	dB(A)	65	65	68	67
Refrigerant gas	Type / GWP					
	Load quantity	kg	1.25	1.5	1.85	2.1
CODE			2CP001PF	2CP001QF	2CP001RF	2CP001SF

INDOOR UNIT		9	12	18
Cooling performance	W	2,640	3,515	5,275
Thermal performance	W	2,930	3,810	5,570
Air flow rate (max-med-min)	m³/h	520 / 460 / 340	600 / 500 / 360	840 / 680 / 540
Sound pressure (max-med-min-slo)	dB(A)	40 / 30 / 26 / 21	40 / 34 / 26 / 22	44 / 37 / 30 / 25
Sound pressure (max)	dB(A)	54	53	55
Liquid / gas line connections	inches	1/4" - 3/8"	1/4" - 3/8"	1/4" - 1/2"
CODE		2CP001HF	2CP001IF	2CP001JF

(1) External air temperature = 35°C D.B. • Room air temperature = 27°C D.B. / 19°C W.B. - (2) External air temperature = 7°C D.B. / 6°C W.B. • Room air temperature = 20°C D.B. - (3) Sound pressure measured at a distance of 1 m: E.U. in open area, I.U. in 100 m³ room with 0.5 second reverberation time
* nominal data, check combinations on the following pages


FIELD OF APPLICATION

OPERATING MODE	PARAMETER		INDOOR SIDE	OUTDOOR SIDE
Cooling	Input air max/min temperature (B.S.)	°C	32 / 17	50 / -15
Heating	Input air max/min temperature (B.S.)	°C	30 / 0	30 / -15
All	Power voltage / frequency	V	230±10% / 50±2	

LIMITS ON LENGTH AND HEIGHT DIFFERENCE OF COOLING PIPES

The length of the cooling pipes between the indoor and outdoor units must be the shortest possible and is, in any case, limited by the maximum values in height difference between the two units.

With the decrease in the difference in height between the units (H1,H2) and the length of the pipes (L), the load loss will be limited, thus increasing the overall performance of the machine. Observe the limits indicated in the following tables.

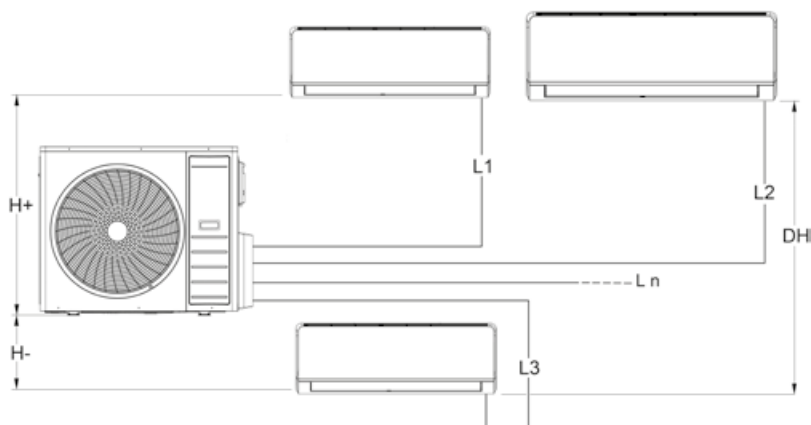

OUTDOOR UNIT			18-2	21-3			27-3			28-4			
Diameter	Liquid	“	1/4”	1/4”	1/4”	1/4”	1/4”	1/4”	1/4”	1/4”	1/4”	1/4”	1/4”
	Gas	“	3/8”	3/8”	3/8”	3/8”	3/8”	3/8”	3/8”	3/8”	3/8”	3/8”	1/2”
Tot. maximum length		m	40	60			60			80			
Maximum length single unit		m	25	30			30			35			
Maximum height difference	H+	m	15	15			15			15			
	H-	m	15	15			15			15			
	DH	m	10	10			10			10			
Maximum total length of piping with standard charge		m	7.5	7.5			7.5			7.5			
Additional quantity of refrigerant per metre		g/m	12	12	12	12	12	12	12	12	12	12	24

TABLE OF POSSIBLE COMBINATIONS

OUTDOOR UNIT	INDOOR UNIT CONNECTED					
	1	2	3	4	5	6
18-2	9K	9K+9K	-	not included		not included
	12K	9K+12K	-			
	18K	12K+12K	-			
21-3	9K	9K+9K	12K+12K	9K+9K+9K	-	not included
	12K	9K+12K	-	9K+9K+12K	-	
	18K	9K+18K	-	-	-	
27-3	9K	9K+9K	12K+12K	9K+9K+9K	9K+12K+12K	not included
	12K	9K+12K	12K+18K	9K+9K+12K	12K+12K+12K	
	18K	9K+18K	-	9K+9K+18K	-	
28-4	9K	9K+9K	12K+12K	9K+9K+9K	9K+12K+12K	9K+9K+9K+9K
	12K	9K+12K	12K+18K	9K+9K+12K	12K+12K+12K	9K+9K+9K+12K
	18K	9K+18K	18K+18K	9K+9K+18K	-	-

NB:

• combinations for which the total power required by the indoor units is compatible with the nominal power of the outdoor unit.

• combinations for which the total power required by the indoor units is higher than the nominal power of the outdoor unit. In the event of a simultaneous request for power by all the units connected, the power available for the individual units will be in line with the indications given in the previous table.

PERFORMANCE IN COOLING MODE

EU	IU	Combination	Partial capacity (kW)				Total capacity in cooling (kW)			Power absorbed			Current absorbed			EER	SEER	Energy Class
			Room							Total (kW)			Total (A)					
			A	B	C	D	Min	Nom	Max	Min	Nom	Max	Min	Nom	Max	Nom		
18-2	1	9	2.50	—	—	—	1.43	2.50	3.20	0.35	0.75	0.93	1.52	3.24	4.06	3.35	—	—
		12	3.50	—	—	—	1.43	3.50	3.90	0.35	1.08	1.29	1.52	4.68	5.62	3.25	—	—
	2	9+9	2.65	2.65	—	—	2.12	5.30	6.41	0.54	1.64	2.05	2.35	7.13	8.92	3.23	6.1	
		9+12	2.27	3.03	—	—	2.12	5.30	6.41	0.54	1.64	2.05	2.35	7.13	8.92	3.23	6.1	
		12+12	2.65	2.65	—	—	2.12	5.30	6.41	0.54	1.64	2.05	2.35	7.13	8.92	3.23	6.1	
21-3	2	9+9	2.65	2.65	—	—	2.01	5.30	6.41	0.57	1.64	2.08	2.46	7.13	9.03	3.23	5.6	
		9+12	2.57	3.43	—	—	2.01	6.00	6.59	0.57	1.86	2.12	2.46	8.08	9.20	3.23	5.6	
		9+18	2.10	4.20	—	—	2.01	6.30	6.83	0.57	1.94	2.17	2.46	8.45	9.44	3.24	5.6	
		12+12	3.10	3.10	—	—	2.01	6.20	6.83	0.57	1.92	2.17	2.46	8.35	9.44	3.23	5.6	
	3	9+9+9	2.10	2.10	2.10	—	2.44	6.30	7.32	0.68	1.94	2.36	2.96	8.45	10.26	3.24	6.1	
		9+9+12	1.89	1.89	2.52	—	2.44	6.30	7.32	0.68	1.94	2.36	2.96	8.45	10.26	3.24	6.1	
27-3	2	9+9	2.65	2.65	—	—	2.21	5.30	7.11	0.64	1.64	2.45	2.76	7.13	10.63	3.23	5.6	
		9+12	2.57	3.43	—	—	2.21	6.00	7.51	0.64	1.86	2.57	2.76	8.08	11.17	3.23	5.6	
		9+18	2.27	4.53	—	—	2.21	6.80	7.90	0.64	2.09	2.69	2.76	9.10	11.70	3.25	5.6	
		12+12	3.15	3.15	—	—	2.21	6.30	7.66	0.64	1.94	2.64	2.76	8.45	11.48	3.24	5.6	
		12+18	2.72	4.08	—	—	2.21	6.80	7.90	0.64	2.09	2.69	2.76	9.10	11.70	3.25	5.6	
	3	9+9+9	2.63	2.63	2.63	—	2.77	7.90	8.69	0.76	2.45	2.91	3.30	10.63	12.65	3.23	6.1	
		9+9+12	2.37	2.37	3.16	—	2.77	7.90	8.69	0.76	2.43	2.91	3.30	10.57	12.65	3.25	6.1	
		9+12+12	2.15	2.87	2.87	—	2.77	7.90	8.69	0.76	2.43	2.91	3.30	10.57	12.65	3.25	6.1	
28-4	2	12+12+12	2.63	2.63	2.63	—	2.77	7.90	8.69	0.76	2.43	2.91	3.30	10.57	12.65	3.25	6.1	
		9+9	2.65	2.65	—	—	2.05	5.30	6.81	0.64	1.64	2.29	2.76	7.13	9.95	3.23	6.1	
		9+12	2.57	3.43	—	—	2.05	6.00	6.98	0.64	1.86	2.41	2.76	8.08	10.50	3.23	6.1	
		9+18	2.43	4.87	—	—	2.05	7.30	7.55	0.64	2.26	2.80	2.76	9.83	12.16	3.23	6.1	
		12+12	3.25	3.25	—	—	2.05	6.50	7.39	0.64	2.01	2.49	2.76	8.75	10.83	3.23	6.1	
		12+18	2.92	4.38	—	—	2.05	7.30	7.55	0.64	2.26	2.80	2.76	9.83	12.16	3.23	6.1	
		18+18	3.75	3.75	—	—	2.05	7.50	7.55	0.64	2.32	2.80	2.76	10.10	12.16	3.23	6.1	
	3	9+9+9	2.37	2.37	2.37	—	2.63	7.10	8.46	0.76	2.20	2.95	3.32	9.56	12.82	3.23	6.1	
		9+9+12	2.34	2.34	3.12	—	2.63	7.80	8.46	0.76	2.41	2.95	3.32	10.50	12.82	3.23	6.1	
		9+9+18	1.95	1.95	3.90	—	2.63	7.80	8.46	0.76	2.41	2.95	3.32	10.50	12.82	3.23	6.1	
		9+12+12	2.13	2.84	2.84	—	2.63	7.80	8.46	0.76	2.41	2.95	3.32	10.50	12.82	3.23	6.1	
		9+12+18	1.80	2.40	3.60	—	2.62	7.80	8.45	0.76	2.41	2.94	3.31	10.50	12.80	3.23	5.6	
		12+12+12	2.60	2.60	2.60	—	2.63	7.80	8.46	0.76	2.41	2.95	3.32	10.50	12.82	3.23	6.1	
	4	9+9+9+9	2.05	2.05	2.05	2.05	2.87	8.20	9.92	0.86	2.54	3.17	3.75	11.04	13.80	3.23	6.1	
		9+9+9+12	1.89	1.89	1.89	2.52	2.87	8.20	9.92	0.86	2.54	3.17	3.75	11.04	13.80	3.23	6.1	

PERFORMANCE IN HEATING MODE

EU	IU	Combination	Partial capacity (kW)				Total capacity in heating (kW)			Power absorbed Total (kW)			Current absorbed Total (A)			COP	SCOP	Energy Class
			Room				Min	Nom	Max	Min	Nom	Max	Min	Nom	Max	Nom		
			A	B	C	D												
18-2	1	9	3.00	—	—	—	1.56	3.00	3.63	0.32	0.80	1.00	1.39	3.48	4.35	3.75	—	—
		12	3.80	—	—	—	1.56	3.80	4.60	0.32	1.02	1.23	1.39	4.45	5.34	3.71	—	—
	2	9+9	2.79	2.79	—	—	2.23	5.57	6.68	0.51	1.50	2.12	2.22	6.53	9.23	3.71	3.8	
		9+12	2.40	3.20	—	—	2.23	5.60	6.68	0.51	1.51	2.12	2.22	6.56	9.23	3.71	3.8	
		12+12	2.80	2.80	—	—	2.23	5.60	6.96	0.51	1.51	2.12	2.22	6.56	9.23	3.71	3.8	
21-3	2	9+9	2.95	2.95	—	—	2.18	5.90	6.93	0.53	1.59	1.96	2.32	6.91	8.51	3.71	3.8	
		9+12	2.70	3.60	—	—	2.18	6.30	7.13	0.53	1.70	1.99	2.32	7.38	8.66	3.71	3.8	
		9+18	2.20	4.40	—	—	2.18	6.60	7.39	0.53	1.78	2.05	2.32	7.73	8.89	3.71	3.8	
		12+12	3.15	3.15	—	—	2.18	6.30	7.39	0.53	1.70	2.05	2.32	7.38	8.89	3.71	3.8	
	3	9+9+9	2.23	2.23	2.23	—	2.35	6.70	7.92	0.64	1.81	2.22	2.78	7.85	9.67	3.71	4.0	
		9+9+12	2.01	2.01	2.68	—	2.35	6.70	7.92	0.64	1.80	2.22	2.78	7.83	9.67	3.72	4.0	
27-3	2	9+9	3.00	3.00	—	—	2.30	6.00	7.38	0.57	1.61	2.20	2.49	6.99	9.56	3.73	3.8	
		9+12	2.70	3.60	—	—	2.30	6.30	7.79	0.57	1.69	2.31	2.49	7.34	10.04	3.73	3.8	
		9+18	2.33	4.67	—	—	2.30	7.00	8.20	0.57	1.88	2.42	2.49	8.16	10.51	3.73	3.8	
		12+12	3.25	3.25	—	—	2.30	6.50	7.95	0.57	1.74	2.37	2.49	7.58	10.32	3.73	3.8	
		12+18	2.80	4.20	—	—	2.30	7.00	8.20	0.57	1.88	2.42	2.49	8.16	10.51	3.73	3.8	
	3	9+9+9	2.73	2.73	2.73	—	2.87	8.20	9.96	0.68	2.20	2.78	2.96	9.56	12.09	3.73	4.0	
		9+9+12	2.49	2.49	3.32	—	2.87	8.30	9.96	0.68	2.23	2.78	2.96	9.67	12.09	3.73	4.0	
		9+12+12	2.26	3.02	3.02	—	2.87	8.30	9.96	0.68	2.23	2.78	2.96	9.67	12.09	3.73	4.0	
		12+12+12	2.77	2.77	2.77	—	2.87	8.30	9.96	0.68	2.23	2.78	2.96	9.67	12.09	3.73	4.0	
28-4	2	9+9	3.00	3.00	—	—	2.20	6.00	7.30	0.59	1.62	2.13	2.58	7.03	9.28	3.71	3.4	
		9+12	3.00	4.00	—	—	2.20	7.00	7.48	0.59	1.89	2.25	2.58	8.20	9.80	3.71	3.4	
		9+18	2.63	5.27	—	—	2.20	7.90	8.10	0.59	2.13	2.61	2.58	9.26	11.34	3.71	3.4	
		12+12	3.75	3.75	—	—	2.20	7.50	7.92	0.59	2.02	2.32	2.58	8.79	10.11	3.71	3.4	
		12+18	3.20	4.80	—	—	2.20	8.00	8.10	0.59	2.16	2.61	2.58	9.38	11.34	3.71	3.4	
		18+18	4.00	4.00	—	—	2.20	8.00	8.10	0.59	2.16	2.61	2.58	9.38	11.34	3.71	3.4	
	3	9+9+9	2.87	2.87	2.87	—	2.82	8.60	9.06	0.71	2.32	2.75	3.09	10.08	11.96	3.71	3.5	
		9+9+12	2.58	2.58	3.44	—	2.82	8.60	9.06	0.71	2.32	2.75	3.09	10.08	11.96	3.71	3.5	
		9+9+18	2.15	2.15	4.30	—	2.82	8.60	9.06	0.71	2.32	2.75	3.09	10.08	11.96	3.71	3.5	
		9+12+12	2.35	3.13	3.13	—	2.82	8.60	9.06	0.71	2.32	2.75	3.09	10.08	11.96	3.71	3.5	
		9+12+18	1.98	2.65	3.97	—	2.82	8.60	9.06	0.71	2.32	2.75	3.09	10.08	11.96	3.71	3.5	
		12+12+12	2.87	2.87	2.87	—	2.82	8.60	9.06	0.71	2.32	2.75	3.09	10.08	11.96	3.71	3.5	
	4	9+9+9+9	2.23	2.23	2.23	2.23	3.08	8.90	10.65	0.81	2.40	2.96	3.51	10.43	12.89	3.71	3.8	
		9+9+9+12	2.10	2.10	2.10	2.80	3.08	9.10	10.65	0.81	2.45	2.96	3.51	10.66	12.89	3.71	3.8	